
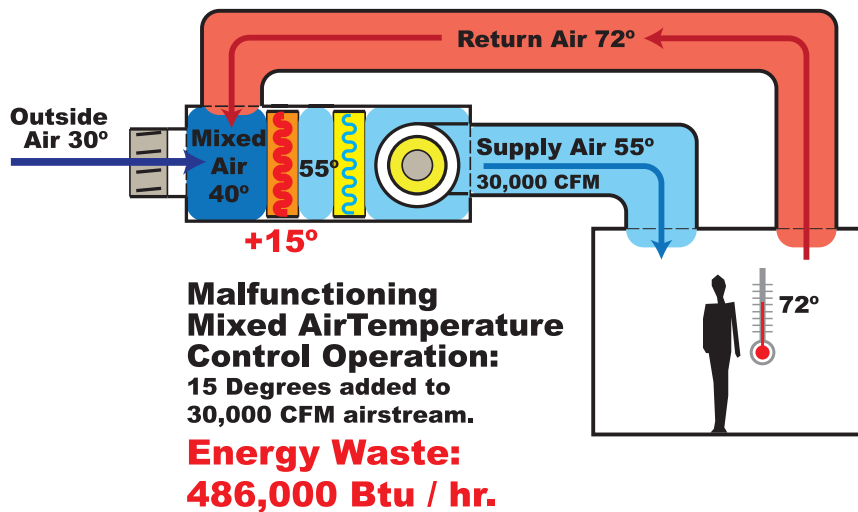


Air Handler Mixed Air Temperature (Economizer) Verification

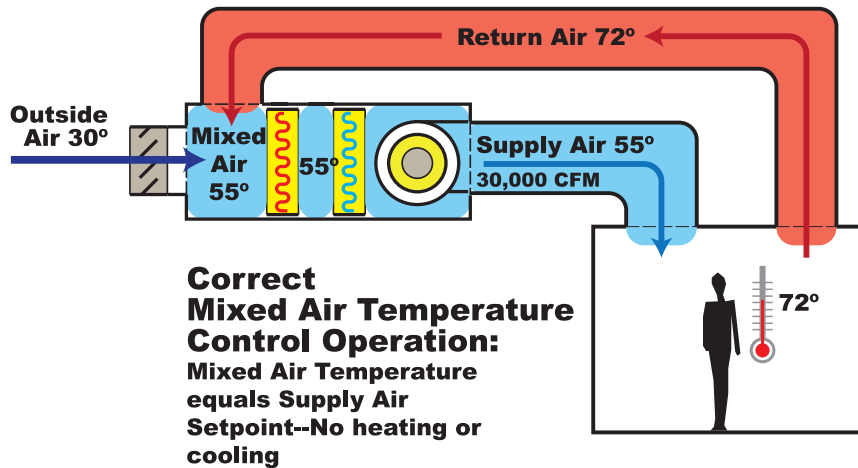

Occupants remain comfortable and submit no complaints; facilities staff is not prompted to look at the air handler.